INSTALLATION, OPERATION & MAINTENANCE MANUAL






COMPLETE PRODUCT LINE

"Australian Pipeline Valve produces isolation, control and flow reversal protection products for severe and critical service media in utility, steam, pipelines, oil & gas and process industries. **APV** valves and pipeline products form the most competitive portfolio in the market."

AUSTRALIAN PIPELINE VALVE BRAND RANGE · CATALOGUES



Product Brochure



Gate, Globe & Check Valves - Cast Steel





Gate, Globe & Check Valves - Forged Steel

APV FAMILY OF BRANDS RANGE - CATALOGUES



Floating Small Bore



Plug Valves Lubricated, Sleeved & Lined



Ball Valves Special Service



Oilfield Products Valves & Wellheads

Flowturn

Instrument Valves









TORQTURN



UNIFLO[®]



Diamond Gear Gearboxes



Flowturn Strainers & Sight Glasses







Torqturn Actuators

& Check Valves



Wafer Check Valves



TwinLok Tube Fittings

. Butterfly Valves VIELO

Superseal

Uniflo Check Valves

Contact us for your local stockist/distributor



Flowturn Gate, Globe



Supercheck



Steamco Steam Valves









Flowturn Ball Valves Multiway & Deadman











INDEX



Introduction	3
Overview	4
Safety Information	4-6
1.0 Installation	6-8
1.1 Installation positions	6-7
1.2 Preparation for installation	7
1.3 Lifting valve	7-8
2.0 Handling	8
3.0 Operation	9
4.0 Gear Operators	9
5.0 Leakage Across Seat	9-10
6.0 Disassembling Valves	10
7.0 Reassembly	10
8.0 Preventative Maintenance	10-11
9.0 Preventing Leakage Across Bonnet Gasket	11
10.0 Major Maintenance	11-12
10.1 Normal maintenance	11
10.2 Packing replacement	11-12
10.3 Seat replacement	12
10.4 Gate replacement	12
11.0 Troubleshooting	13
Appendix A - Bolting torque sequence	14
Appendix B - Design DCNP Series	15
Appendix C - Bill of materials	16
	A 17



INDEX



Appendix D - Bill of materials - manual operated design	17
Appendix E - Bill of materials - double acting actuated design	18
Appendix F - Seat & cylinder selection	19



© Copyright Australian Pipeline Valve 1990 - 2021 Edition

Catalogues, photos, brochures and technical publications are the exclusive property of Australian Pipeline Valve. Any unauthorised reproduction in total or in part, shall result in prosecution. Products and data sheets in this publication are subject to change at anytime without notice. Australian Pipeline Valve reserves the right to carry out amendments to products and materials.



INTRODUCTION

The majority of this information is common knowledge to experienced valve users. When properly installed in applications for which they were designed, Flowturn valves will give long reliable service. This instruction is only a guide for installation and operation on standard service and covers general maintenance and minor repairs. A professional APV approved valve engineering facility should be utilised for reconditioning or major repairs.



We do recommend however that this entire document be read prior to proceeding with any installation or repair. Australian Pipeline Valve and it's parent company take no responsibility for damage or injury to people, property or equipment. It is the sole responsibility of the user to ensure only specially trained valve repair experts perform repairs under the supervision of a qualified supervisor.

RESPONSIBILITY FOR VALVE APPLICATION

The User is responsible for ordering the correct valves. The user is responsible for ensuring APV-Flowturn Valves are selected and installed in conformance with the current pressure rating and design temperature requirements. Prior to installation, the valves and nameplates should be checked for proper identification to ensure the valve is of the proper type, material and is of a suitable pressure class and temperature rating to satisfy the requirements of the service application.



Do not use valves in applications where either the pressure or temperature is higher than the allowable working values. Also valves should not be used in service media if not compatible with the valve material of construction, as this will cause chemical attacks, leakage, valve failure.

RECEIVING INSPECTION AND HANDLING

Valves should be inspected upon receipt to ensure:

- Conformance with all purchase order requirements.
- Correct type, pressure class, size, body and trim materials and end connections.
- Any damage caused during shipping and handling to end connections, hand wheel or stem.



The User is advised that specifying an incorrect value for the application may result in injuries or property damage. Selecting the correct value type, rating, material and connections, in conformance with the required performance requirements is important for proper application and is the sole responsibility of the user.



OVERVIEW

The Flowturn knife gate Series DCNP one-piece, cast body design offers rugged performance in application ranging from general purpose to severe media handling. Available with integral metal or replaceable soft seat, the Flowturn knife gate Series DCNP value is easily automated for on/off applications.

Valve features include:

- Top works designed for easy, quick conversion between manual and pneumatic actuation. Manual valves include a lubricant injection port for continuous, smooth operation with minimal maintenance.
- Clevis design and horizontal bolting stabilises gate ensuring proper alignment.
- Energised quad seal packing for enhanced gland sealing.
- Standard integral metal seat and optional replaceable zero leakage resilient seats.
- Gate design ensures consistent alignment throughout the length of the stroke.
- Unique body design with no dead pockets enables self-draining of valve.

SAFETY INFORMATION

The following general safety information should be taken in account in addition to the specific warnings and cautions specified in this manual. They are recommended precautions that must be understood and applied during operation and maintenance of the equipment covered in this I.O.M.



To avoid injury, never attempt disassembly while there are pressures either upstream or downstream. Even when replacing stem packing, caution is necessary to avoid possible injury.



To prevent valve bending, damage, inefficient operation, or early maintenance problems, support piping on each side of the valve.



A valve is a pressurised mechanism containing energised fluids under pressure and consequently should be handled with appropriate care.
Valve surface temperature may be dangerously too hot or too cold for skin contact.
Upon disassembly, attention should be paid to the possibility of releasing dangerous and or ignitable accumulated fluids.
Ensure adequate ventilation is available for service.

This manual provides instructions for storing, general servicing, installation and removal of gate and globe valves.

APV and it's re sellers refuse any liability for damage to people, property or plant as well as loss of production and loss of income under any circumstances but especially if caused by: Incorrect installation or utilisation of the valve or if the valve installed is not fit for intended purpose. It is the sole responsibility of the user to ensure the valve type and materials are correctly specified.

DURING OPERATION TAKE INTO ACCOUNT THE FOLLOWING WARNINGS:

- a-Graphite/Graphoil packing and body gaskets are very brittle, any impacting, twisting or bending should be avoided.
- b-The valve's internal parts such as disc, stem, seats, seals, gaskets shall be handled with care avoiding scratches or surface damage.
- c- All tools and equipment for handling the internal parts shall be soft coated.
- d-Valves can be fitted with gaskets or seals in PTFE, Buna, EPDM, NBR, Viton, etc., Hence chemicals or high temperatures will damage sealing components.
- e-Never part open valve or part close, gate valves must be full open of full closed to avoid seat damage. Globe valves can be used to throttle (on clean service only) for short periods but must be at least 25% open or else venturi action will damage seating area and body.

For all operations make reference to position number on part list of the applicable drawing listed.



Packing leakage could result in personal injury. Valve packing is tightened prior to shipping but may require readjustments to meet specific service conditions.





Personal injury may result from sudden release of any process pressure. APV recommends the use of protective clothing, gloves and eye wear when performing any installation or maintenance.

Isolate the valve from the system and relieve pressure prior to performing maintenance.

Disconnect any operating line providing air pressure, control signals or electrical power to actuators.



Check the packing box for pressurised process fluids even after the valve has been removed from the pipeline, particularly when removing packing hardware or packing rings, or removing packing box pipe plug if fitted.



If a gasket seal is disturbed while removing or adjusting gasketed parts, APV recommends installing a new gasket while reassembling. A proper seal is required to ensure optimum operation.

1.0 INSTALLATION



Piping should be properly aligned and supported to reduce mechanical loading on the end connections.

1.1 INSTALLATION POSITIONS

DCNP gate valves are unidirectional, the direction of flow will be indicated on the valve body.

Gate valves should be installed with the stem in a vertical up position on horizontal lines. Never install with the stem below the horizontal axis, as complete drainage is not possible and solids may accumulate in the valve bonnet, which will greatly affect the valve operation and service life. If valves are to be installed in vertical lines, please specify at time of order as this is non standard.

Reliable support is required for valves with larger diameter (size over DN300), heavy actuator or uncommon positions.



Special care should be taken to maintain the correct distance between the flanges and to ensure that they are parallel to valve body. Incorrect alignment of valve will cause deformations, which can lead to difficulties in operation.

Install 2-3 studs on the body button loosely.

Insert the appropriate gaskets between valve and pipe flanges. The materials of the gasket is up to the customers selection. Customer can also consult our technicians for suggestions.

Place studs in balance positions and tighten evenly in a cross over pattern. Care should be taken when the body drilling cavity studs are tightened to ensure no damage to the valve body. See Appendix A for bolt tightening sequence.

1.2 PREPARATION FOR INSTALLATION


- Remove protective end caps or plugs and inspect valve ends for damage to flange faces.
- Thoroughly clean adjacent piping system to remove any foreign material that could cause damage to seating surfaces during valve operation.
- Verify that the space available for installation is adequate to allow the valve to be installed and to be operated.




Ensure sufficient clearance for the stem in the full open position. Inadequate clearance for valves may add mechanical loading to the valve ends. Sufficient clearance should be allowed for threaded end valves to be 'swung' during installation.


1.3 LIFTING VALVE

Refers to Figures 1 to 8 below on lifting methods for horizontal and vertical lifting.







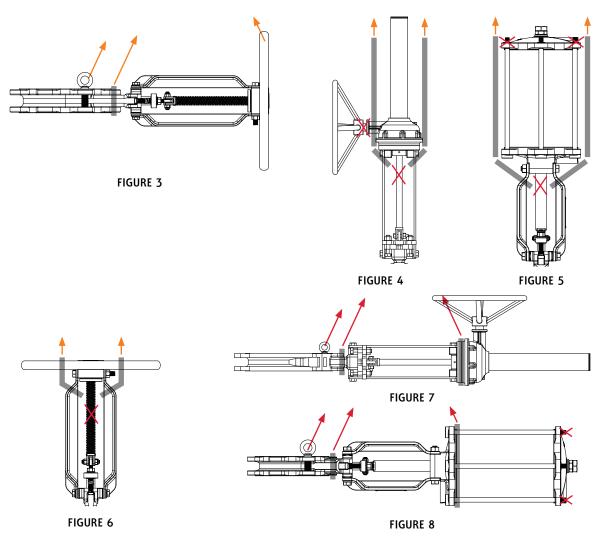

2.0 HANDLING

- 1. Take care in handling valves especially the sealing faces.
- 2. Make sure that piping and equipment is clean of dust, rust and pipeline scale. Clean all adjoining pipe and fittings. Remove end protector covers from the valves immediately prior to installation. Blow compressed air inside the valves to remove residual dust, dirt, etc., from inside the valves as this could hamper the valves functioning and could also damage the seats.
- 3. Make joints tight but do not overstress them. This is very important when your tightening gland packing nuts. Always tighten in a diagonal pattern, gradually increasing torque settings.
- 4. Install valves in the connecting piping so that the arrow mark on the valve body coincides with the flow direction in the pipe.
- 5. After installation it is advisable to once again flush the piping. Check carefully for visible leaks if any and tighten stem packing and/or bonnet nuts accordingly.
- 6. If the leakage still persists change the bonnet gasket.



3.0 OPERATION

- 1. Check visibly for any leaks and re-tighten the joints/glands.
- 2. Manually operated valves are to be operated through handwheel. To open the valve, turn the handwheel anti-clockwise. To close the valve, turn the handwheel in clockwise direction.
- 3. Turn the handwheel slowly initially so as to prevent undue stress on the valves due to thermal gradient, water hammering, etc.
- 4. Never use too much force for either closing or opening the valve, never attempt to apply leverage with a long lever as this could damage yoke nut.
- 5. Operate the valve with no flow in the pipeline for one cycle to make sure smooth operation.
- 6. Then test operation and valve seal with flow. When the pressure is increasing gradually to full pressure, there might be minor leakage at packing result from shipping and storage. This can be remedied by tightening the gland follower. The nuts should be tightened gradually and crosswise until the leakage stops.
- 7. Operate the valve under full pressure for one cycle to test the seal and actuator.
- 8. If no problem occurs, valve is good for on-off processing.
- 9. NOTE: Knife gate valves are not designed for flow throttling, as this will lead to gate damage.

4.0 GEAR OPERATORS

The gear operator is lubricated with grease (2% MOS2) for life.

Only in case of failure of any components remove the upper gear casing from lower gear casing. After inspection replace the necessary components.

- 1. When repairing the drive sleeve and bearing (thrust ball bearing) there should not be any clearance, i.e. the drive should not move axially.
- 2. Proper installation will correct operation.



Do not dismantle the upper and lower gear casing as it will disturb the whole assembly and the deep groove ball bearings, the operator provided is properly lubricated for long life.

5.0 LEAKAGE ACROSS SEA

It is always difficult to ascertain whether there is an internal seat leakage unless there is pressure or leak detection facility in place to monitor any rise or fall in pressure or leakage.

To investigate suspected leakage, the valve should be removed from the line then dismantled. Prior to removal from line ensure all pressure and fluid is purged from line and valve cavity. Remove disc and



inspect the seating surfaces, also inspect the body seat for any sign or wire drawing/light scratches.

Relap or replace the seats or gate as required if minor damage or else send the valve to an experienced APV approved valve repair facility. Assemble the valve, should any leaks still persist then the concerned part may need complete replacement.

When ordering spare parts for replacements, kindly inform us the size, type, rating, part description, model number and serial number.

6.0 DISASSEMBLING VALVES

- 1. Check that the line is in a complete shut down phase.
- 2. Pre-order all necessary spare gland packings and jointing gaskets.
- 3. Open the valve slightly by turning the handwheel anti-clockwise and loosen the gland.
- 4. Remove any process product observing all safety precautions.
- 5. Put identification markings on valve body, bonnet, disc/gate, yoke, and actuator. This helps to avoid mismatching of parts at the time of re-assembly.
- 6. If the bolts and nuts are too tight, apply deep penetrating oil and then unscrew.

Also refer to section 10.0 for detailed instructions.

7.0 REASSEMBLY

- 1. Re-assemble in reverse order of disassembly.
- 2. For larger valves, lift up the bonnet using lifting lugs where provided. For smaller valves, gently and evenly break the bonnet seat with a lever (if required) before lifting the bonnet off (where required use with a sling mechanical lifting device). Clean gasket surface areas, replace gasket and refit bonnet.
- 3. Refer Appendix A for bonnet bolt re-tightening procedure.
- 4. Before installation do inspection on valve;
 - a) Make sure the valve body and components are in good condition.
 - b) Make sure internal cavities of valve body are clean.
 - c) Make sure corresponding flange and pipe line are free of foreign material.

Also refer to section 10.0 for detailed instructions.

8.0 PREVENTATIVE MAINTENANCE

- 1. Inspect whether all valves can be opened or closed smoothly at least once a month. If the operation is sluggish, clean the spindle threads and lubricate the same.
- 2. Check the gland tightening nuts for any leaks or slackness, if required tighten these nuts and ensure



that the valve operation is not hampered by over tightening the gland.

3. The manual valve stem should be lubricated at regular intervals with industrial grease for smooth operation of the valve. A lubrication nipple is provided on the collar.

Note, use genuine APV new gland packing sets when replacing.



Do not attempt to repack the stem packing in line while the valve is under pressure. The line must be totally purged. Knife Gate valves do not all have the 'back seating' feature. Prior to removing bonnet, exercise extreme caution no pressure is trapped in the valve cavity. Wear appropriate safety apparel and follow industry and plant safety procedures.

9.0 LEAKAGE ACROSS GASKET

Should any body gasket leaks occur, tighten the bolts/nuts & studs (refer Diagram 1, Appendix A). If leakage still persists, the bonnet gasket should be changed.

10.0 MAJOR MAINTENANCE

Only an expert APV approved valve re-conditioner should attempt the following major extraordinary maintenance/repairs.

10.1 NORMAL MAINTENANCE

- 1. Grease the valve stem periodically. Rotate the stem protector counter clockwise to take it off. Apply grease to the stem and cycle the valve once.
- 2. There would be minor leakage at the packing after long term operation. This can be solved by tightening the bolts on gland follower in crosswise pattern.

10.2 PACKING REPLACEMENT



First remove the valve from the line. To prevent injury ensure that all fluid and pressure is removed from the valve both upstream and downstream before removal and disassembly. When removing drain or stem plug wear protective eye masks to avoid injury.

Refer to Appendix C for exploded bill of materials.

- 1. Depressurise the circuit and place the valve in closed position.
- 2. Remove the gate guards.



- 3. Release stem from the gate.
- 4. Loosen screws at the bottom of the yoke, and take off actuator of handwheel with yoke connected on.
- 5. Remove old packing and clean the packing cavity.
- 6. Insert new packing and tighten the gland follower steadily.
- 7. Place yoke (with actuator or handwheel mounted on) and screw it on the valve.
- 8. Connect stem to gate.
- 9. Mount gate guards.
- 10. Perform several operation cycles with loaded pipeline and adjust the gland followers to ensure no leakage.



The stem packing system will vary according to valve size, type and class as well as the stem packing material specified.

10.3 SEAT REPLACEMENT

- 1. Remove valve from pipeline.
- 2. Take seat retainer off.
- 3. Remove the old seat and clean the cavity.
- 4. For metal or PTFE seat, lubricate the o-ring, then place it on the seat groove.
- 5. Insert the new seat.
- 6. Mount the seat retainer using the cross-over method.
- 7. Perform several operation cycles with loaded pipeline to make sure the seal is tight.

10.4 GATE REPLACEMENT

- 1. Perform step 1. to step 5. of packing replacement as shown above in 10.2.
- 2. Remove seat and gate guide points (right above the valve inlet port).
- 3. Remove the old gate.
- 4. Clean body cavity and insert new gate in carefully (no impact with the valve cavity).
- 5. Re-install the seat.
- 6. Perform step 6. to 10. of packing replacement as shown above in 10.2.
- 7. After assembly, re-tighten gate scraper guides.

Do <u>not</u> over tighten bolts. Hydrostatically test the valve to ensure that there is no leakage. Refer to Diagram 1, Appendix A for bolt tightening sequence.



Always be sure that the valve is de-pressurised and isolated prior to performing any maintenance work. Do not attempt to repair valve in-line if volatile, dangerous, hazardous or flammable service. Always wear fully enclosed, splash proof, protective eye wear.



11.0 TROUBLESHOOTING


TROUBLE	POSSIBLE CAUSE	SOLUTION				
Packing Leakage	 > Incompatible media > Packing deterioration > Temperature variation > Normal packing wear 	Replace packing				
Soft Seated Valve: In fully close position, seat leakage	Seat is worn or damaged	 a) Remove worn or damaged seat b) Inspect and clean seat chamber, install new seat c) Tighten gate scraper guides 				
	Gate is damaged	Replace gate				
High torque during valve seating and unseating	Entrapped foreign media in pipeline prohibiting valve from seating	Consult factory for proper solutions				
	Gate scraper guides too tight					
	Packing not tighten to recommended torque	a) Remove valve from service b) Review gate to seat interface				
Unable to close or open gate	Solidified media between body and gate	 a) Check for valve orientation, flow direction and flow indication b) Re-orient valve c) Replace gate d) Clean chest area of valve 				
Valve jerks during open and close	Superstructure fasteners loosened	Tighten the superstructure fasteners				
	Insufficient air supply	Pneumatic operated valves; increase supply pressure				
	Solenoid valve dust accumulation	Remove and clean solenoid valve				
	Piston rod seal damaged	Replace seal				
	Packing is too tight	Loosen packing				



APPENDIX A

BOLTING TORQUE SEQUENCE

DIAGRAM 1



Bolting torque sequence: 1 - 2 - 3 - 4 - 5 - 6 - 7 - 8

Example only, number of bolts will vary, apply the same criss cross process, gradually tightening more after each revolution.



APPENDIX B

DESIGN

Flanging

ANSI B16.1/B16.5 125lb/150lb AS 2129 Table D, E AS 4087 PN14, PN16 AS 4331.1 PN10, PN16 EN 1092-2 PN10, PN16 ISO 7005-1 PN10, PN16

Pressure/Class Rating

PN10 Rated body. Long term maximum packing rating: 10 bar to 250NB 7 bar 300 ~ 450NB 4 bar 500 ~ 600NB


Face to Face Dimensions AS 6401 & MSS SP-81

Test Standards

MSS SP-71, ISO 5208, MSS SP-61

Pressure/Temperature Rating Seat


NBR 10 bar -10°C to 90°C EPDM 10 bar -10°C to 120°C Viton 10 bar -10°C to 200°C PTFE 10 bar -10°C to 200°C Metal to Metal 10 bar -10°C to 200°C

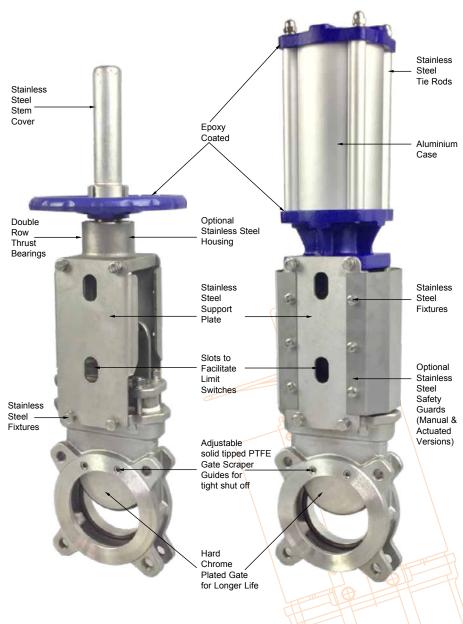

Resilient seated uni-directional valves are tested leak tight up to 4 Bar (Elastomer) and 2.8 Bar (PTFE) on seat. The Flowturn DCNP is one of the only Knife Gate designs in the world offering a rugged and flexible PTFE seated valve with a tight shut-off. Above 4 Bar these pressures seat leakage rate is estimated at up to 2.66 drops/minute/inch (0.11 drips/minute/DN) as per MSS-SP61. However an actual seat test can be performed above 4.0 Bar if required. Special packing systems and bonnet designs are available for high pressure applications. Flow direction is from the opposite side of the valve for the seat This provides superior shut-off by pressure energising the gate against the seat and also protects the seat.




APPENDIX C

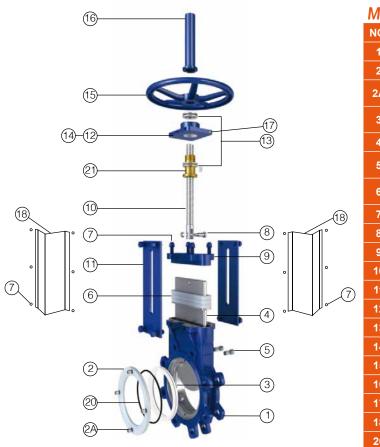


MATERIALS NO. PART NAME MATERIAL Body CF8M/CF8/WCB+FBE SS316/SS304/WCB+FBE Seat Retainer Seat Retainer A2-70 SS/A4-70 SS 2A **Tension Screws** Metal STL#6/HCr/NBR/PTFE/ Seat EPDM/Viton Gate SS304/SS316+HCr Adjustable Gate SS304/SS316+Solid PTFE Guide PTFE Braided+Silicon+PTFE 6 Packing Multi-Layer Sheet Bolts A2-70 SS/A4-70 SS 8 Pin SS304 9 Gland CF8M/CF8/WCB+FBE 10 SS304/2CR13 Stem Support Plates SS304 SS316/304/WCB+FBE 12 **Bearing Housing** SS440 Bearings SS304 **Bearing Cover** 15 Handwheel Epoxy Coated Iron Stem Cover SS304 Grease Fitting C95200+2P 18 SS304 Safety Guards 20 O-ring* EPDM/NBR/Viton Stem Drive Nut Brass/SS304 * PTFE and metal seat version

PACKING AREA




SEAT AREA



GATE TENSION GUIDE

Silicon

Sheet




GUIDE CLAWS

PTFE Sheet

PTFE Sheet

Braided PTFE Silicon Laced

6







APPENDIX D

MATERIAL LIST - MANUAL OPERATED

ITEM	PART NAME	MATERIAL						
1	Body	CF8M/CF8/WCB+FBE						
2	Seat Retainer	SS316/SS304/WCB+FBE						
2A	Seat Retainer Tension Screw	A2-70 SS/A4-70 SS						
3	Seat	Metal STL#6/HCr/NBR/PTFE/EPDM/Viton						
4	Gate	SS316/SS304+HCr						
5	Adjustable Gate Guide Scraper SS + Solid PTFE Tip	A2-70/A4-70+PTFE						
6	Packing Multi Layer	Braided PTFE+Silicon+PTFE Sheet						
7	Bolt	A2-70 SS/A4-70 SS						
8	Pin	SS304						
9	Gland	CF8M/CF8/WCB+FBE						
10	Stem	SS304/2CR13						
11	Support Plates	SS304						
12	Bearing Housing	SS316/SS304/WCB+FBE						
13	Bearings	SS440						
14	Bearing Cover	SS304						
15	Handwheel	Epoxy Coated Iron						
16	Stem Cover	SS304						
17	Grease Fitting	C95200						
18	Safety Guards	SS304						
19	Bevel Gear (Ratio 4.5:1)	Assembly						
20*	O-Ring*	EPDM/NBR/Viton						
21	Stem Drive Nut	Brass/SS304						
* Metal a	and PTFE seat version only.							

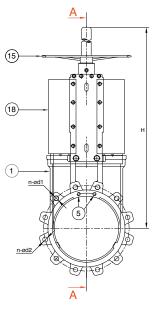




Metal and PTFE seat version only.

DIMENSIONS & WEIGHTS (MM & KG) AS 2129 Table D*/AS 4087 CL14/16

AS 2129 Table D*/AS 4087 CL14/16												
NB	L	н	PCD	øD1	øD2	n-ød1	n-ød2	h1	h2	Т	Weight	
50	48	302	114	90	60	2-M16	2-M16	-	-	-	9.0	
65	48	345	127	103	75	2-M16	2-M16	-	-	-	11.0	1
80	51	365	146	122	90	2-M16	2-M16	-	-	-	12.0	1
100	51	410	178	154	105	2-M16	2-M16	-	-	-	16.0	1
125	57	460	210	186	130	2-M16	6-M16	-	-	-	20.0	
150	57	505	235	211	158	2-M16	6-M16	-	-	-	25.0	
200	70	615	292	266	210	2-M16	6-M16	-	-	-	43.0	
250	70	740	356	324	260	2-M20	6-M20	-	-	-	62.0	1
300	76	840	406	378	310	4-M20	8-M20	-	-	-	78.0	
350	76	970	470	429	360	4-M24	8-M24	-	-	-	112.0	
375	76	1020	495	463	385	4-M24	8-M24	-	-	-	145.0	
400	89	1060	521	489	415	4-M24	8-M24	-	-	-	154.0	1
450	89	1810	584	532	465	4-M24	8-M24	8-M24 1265		35	238.0	
500	114	1950	641	609	515	6-M24	10-M24	1375	15	85	265.0	
600	114	2205	756	720	615	6-M27	10-M27	1570	15	50	300.0	
700	114	-	845	809	710	8-M27	12-M27	1710	15	50	510.0	
750	114	-	927	888	725	8-M30	12-M30	1820	15	50	580.0	
800	114	-	984	942	790	8-M33	12-M33	1950	15	50	640.0	
900	114	-	1092	1050	860	10-M33	14-M33	2100	15	50	850.0	
1000	114	-	1175	1133	980	10-M33	14-M33	2300	15	50	1100.0	
1200	114	-	1410	1368	1180	14-M33	18-M33	2650	15	50	1680.0	

* Will also fit between Table E flanging all sizes (except 100NB, 250NB, 450NB)

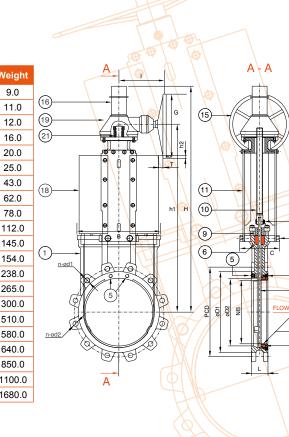

8

(7

(4


(20) 2 3




APPENDIX E

MATERIAL LIST - DOUBLE ACTING ACTUATED VALVE

ITEM	PART NAME	50mm~300mm	400mm & Above				
1	Piston Rod	1045+Hardchrome/304SS	1045+Hardchrome/304SS				
2	Bottom Cover						
		Epoxy Coated Steel	Epoxy Coated Steel				
3	Wear Ring	PTFE+Cu	PTFE+Cu				
4	O-Ring	NBR/Viton	NBR/Viton				
5	O-Ring	NBR/Viton	NBR/Viton				
6	O-Ring	NBR/Viton	NBR/Viton				
7	Piston	Aluminium Alloy	Cr Plated 1045				
8	Cylinder Tube	Aluminium Alloy	Cr Plated 1045				
9	Bolt	A2-70	A2-70				
10	O-Ring	NBR	NBR				
11	Stroke Adjuster	A2-70 SS	A2-70 SS				
12	Cover Caps	Epoxy Coated Steel	Epoxy Coated Steel				
13	Tie Rod	A2-70 SS	A2-70 SS				
14	Seal Retainer	SS304	SS304				
15	Scraper Seal	PTFE	PTFE				
16	Bolt	A2-70 SS	A2-70 SS				
17	O-Ring	NBR/Viton	NBR/Viton				
18	V-Ring	Polyurethane	Polyurethane				
19	Shaft Bearing	Brass	Brass				
20	Shaft Seal	EPDM/NBR/Viton	EPDM/NBR/Viton				







* Metal and PTFE version only.

DIMENSIONS & WEIGHTS - ACTUATED VALVE (MM & KG)

NB	н	w	Cylinder Bore	Stroke	Air Connect	Cylinder Weight	Valve & Actuator Weight
50	457	100	80	60	F1/4	6.3	15.0
65	505	100	80	75	F1/4	6.3	17.0
80	545	120	100	85	F1/4	6.3	18.0
100	615	120	100	105	F1/4	6.3	22.0
125	680	150	125	135	F1/4	9.2	29.0
150	780	150	125	160	F3/8	9.2	34.0
200	950	195	160	210	F3/8	26.0	69.0
250	1135	240	200	260	F3/8	39.0	101.0
300	1320	280	250	310	F3/8	60.0	138.0
350	1510	395	300	360	F3/8	103.0	215.0
375	1610	395	300	410	F3/8	103.0	230.0
400	1650	395	300	410	F3/8	103.0	250.0
450	2005	423	350	460	F3/8	136.0	320.0
500	2285	423	350	510	F3/8	138.0	360.0
600	2385	440	400	610	F3/8	146.0	392.0

fer to APV sizing guide. Air supply 4 bar to 7 ba

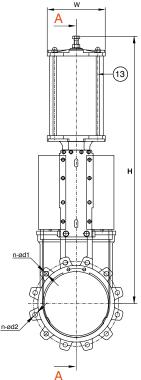

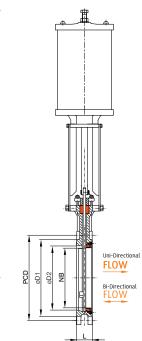

A - A



APPENDIX F

SEAT & CYLINDER SELECTION

RESILIENT SEAT SERVICE APPLICATIONS

The following is general information and materials required for special application should be specified.

Common Name	ASTM Code	Max. Temp	Mild Abrasion	Aging	Water Resistance	Oil Resistance	Solvent	Strong Acid	Weak Acid	Strong Alkali	Weak Alkali
Buna-N/NBR	NBR	93°C	Ø		tØ	Ø	□ ~ X	х	Ø	Ø	Ø
Neoprene	CR	93°C	Ø	Ø	Ø		Х	Х		Ø	Ø
Natural Rubber	NR	65°C	ø	Ø	ø	х	х	х	ø	ø	ø
EPT	EPDM	121°C	Ø	Ø	ø	х	Х	Δ		Δ	Ø
Silicon	Si	160°C	Ø	Ø	ø	Х~П		Х	Ø	Ø	Ø
Viton	FPM	160°C			Ø*	Ø	Ø	Ø*	Ø	Ø	Ø
PTFE	D-1457	160°C	Ø**	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø

* Cold only, not hot. **High impact resistant.

Note: Ø Excellent, \Box Good, \bigtriangleup Fair, X Poor

SIZING INFORMATION FOR HEAVY DUTY AIR CYLINDER OPERATOR DC SERIES

Cylinders for air, oil and water for Knife Gate Valves with line differential pressures of 276 kPa through 552 kPa. This is a rough estimatings guide. Sizes shown is the bore of the cylinder.


	tor Air oply	276 kl	Pa. Air	345 kl	Pa. Air	414 ki	Pa. Air	483 ki	Pa. Air	552 kl	Pa. Air	621 kPa. Air		689 kl	Pa. Air
Valve Size	Valve Size		nder ze	Cylinder Size			nder ze								
(mm)	(in)	М	R	М	R	М	R	М	R	м	R	м	R	М	R
80	3"	102	100	100	100	76	76	76	76	76	76	64	64	64	64
100	4"	127	127	127	127	100	100	100	100	100	100	100	100	76	76
150	6"	152	152	152	152	125	125	125	125	125	125	125	125	100	100
200	8"	200	200	200	200	200	200	152	152	152	152	152	152	127	127
250	10"	254	254	250	250	200	200	200	200	200	200	200	200	150	150
300	12"	305	305	250	250	250	250	250	250	200	200	200	200	200	200
350	14"	356	356	300	300	300	300	250	250	250	250	250	250	200	200
400	16"	406	406	350	350	300	300	300	300	250	250	250	250	250	250
450	18"	406	406	400	400	350	350	300	300	300	300	300	300	250	250
500	20"			400	400	400	400	350	350	350	350	300	300	300	300
600	24"							400	400	400	400	350	350	350	350


"M" indicates metal-seated valve "R" indicates one side DCNP resilient-seated valve

This is a "ready reckoner" for 'DCNP" series - but is a guide only. Cylinder size varies depending on model, pressure, seat type, configuration and media Service viscocity and other factors can dramatically effect sizing. DCNP Actuator air supply .41 ~ .585 mpa operating minimum .375 mpa maximum .7 mpa

For slurry service next size up is required, lease consult us. Special slurry design valve required.



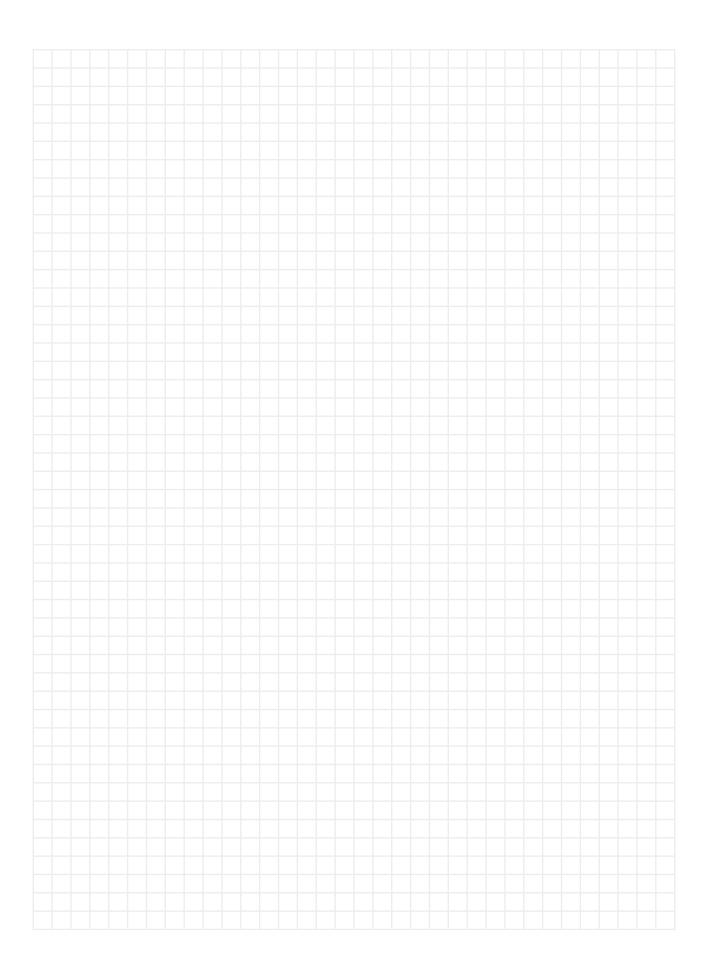

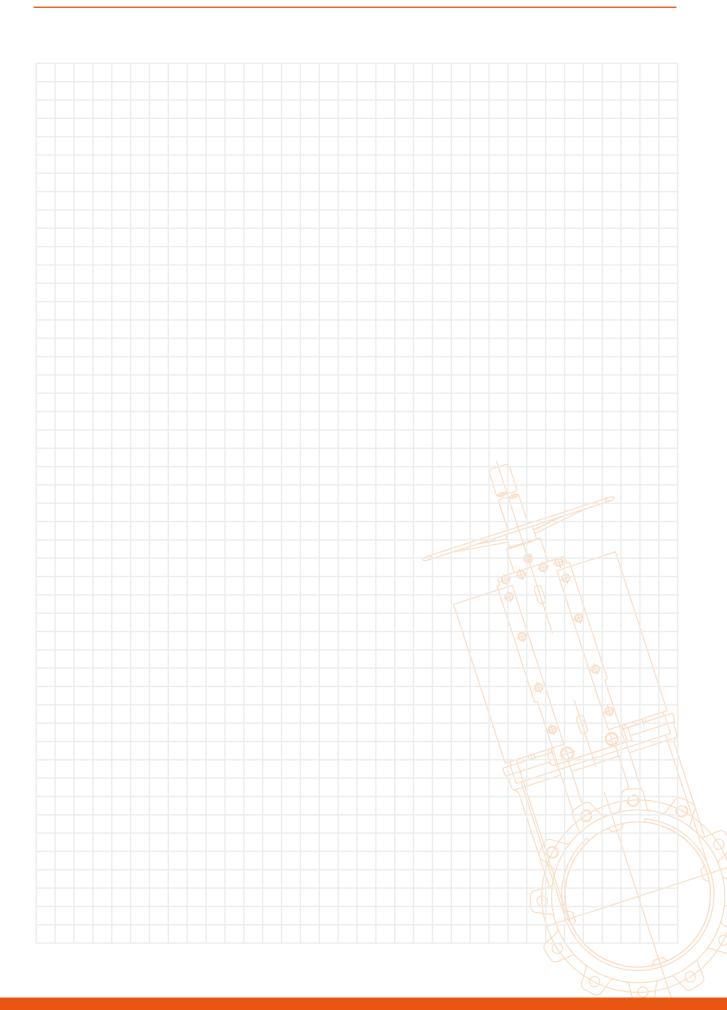







ADELAIDE • BRISBANE • PERTH



AUSTRALIAN PIPELINE VALVE® HEAD OFFICE 70-78 Stanbel Road Salisbury Plain South Australia 5109 Telephone +61 (0)8 8285 0033 Fax +61 (0)8 8285 0044 email: admin@australianpipelinevalve.com.au

www.australianpipelinevalve.com.au



If you have any requirements in the field of valves, please contact us for a prompt response. Continuous development of Australian Pipeline Valve products may necessitate changes in the design or manufacture process. Australian Pipeline Valve reserves the right to effect any such changes without prior notice:

LOCAL DISTRIBUTOR/AGENT

OM Flowturn Knife Gate